

Product Code

CNG050S290NCAAEZZZ

PUCK700

Serial ID

15356460

34356056

Order ID 10565460

Line 1.1

Item 3

Customer Tag

SN 24071468



Process

Detail

Process ID : 1.37235262

Process Time : 2023.03.24 14:46:19

Process Stand : TSM1A@SSCB:1

Stand Uncertainty : +/-0.030%

Fluid : H2O

100% Rate : 38.6 KG/MIN

Pickoff : 1

Max Rate P/T : 33.01 PSIG/22.4 C

Results

Status : PASS

D1 : 0

D2 : 1

K1 : 4111.444

K2 : 4280.243

DT : 4.25

FD : 0

DTG : 0

DFQ1 : 0

DFQ2 : 0

FlowCal : 138.724.50

FFQ : 0

FTG : 0

DensCal : 04111042804.25


FCF : 138.72

FT : 4.5

MENDEZ, FRANCISCO

Technician

This certificate is produced by an electronic data system and is valid without signature.

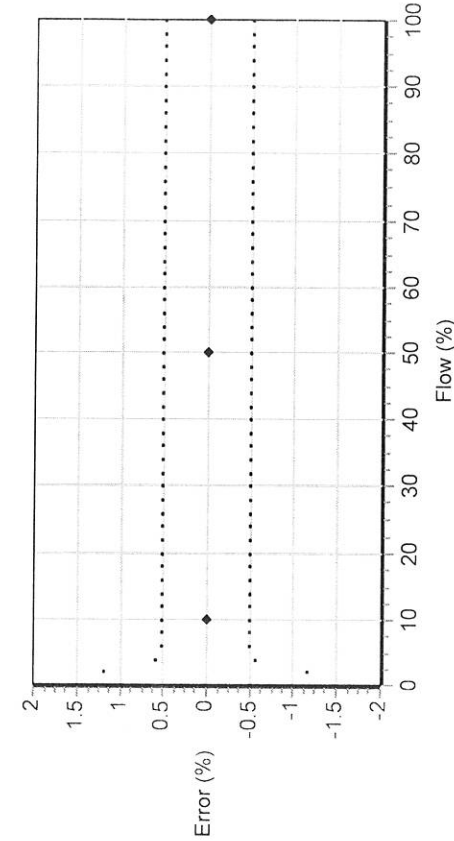

Flow (%)	Flow Rate (kg/min)	Meter		Reference		Error (%)	Specification (±%)
		Total (kg)	Total (kg)	Total (kg)	Total (kg)		
100.0	38.6	38.0834	38.08686	38.08686	38.08686	-0.009	0.500
10.0	3.86	4.030548	4.03024	4.03024	4.03024	0.008	0.500
50.0	19.3	19.46116	19.46263	19.46263	19.46263	-0.008	0.500
100.0	38.6	37.99848	37.99694	37.99694	37.99694	0.004	0.500

Product Code

CNG050S290NCAAEZZZ

2700I13ABAEZWZ

PUCK700

Serial ID

15356460

12232700

34356056

Order ID

10565460

10565460

Line Item

1.1 3

1.33 3

Customer Tag

SN 24071468

Process

Process ID : 1.37235625

Process Time : 2023.03.24 17:05:54

Process Stand : CONFIGURATION@SSCB

Sensor

Units

D1 : 0

D2 : 1

DFQ1 : 0

DFQ2 : 0

DT : 4.25

DTG : 0

Dens PCF : 0

Density Meter Factor : 1

FCF : 138.72

FD : 0

FFQ : 0

FT : 4.5

FTG : 0

Flow PCP : 30

Flow PCF : 0

K1 : 4111.444

K2 : 4280.243

Mass Flow Meter Factor : 1

Volume Flow Meter Factor : 1

Units

Density Unit : G/CM3

GSV Flow Unit : SCFM

Mass Flow Unit : G/SEC

Pressure Unit : POUNDS/SQUARE INCH

Special GSV Base Time Unit : MIN

Special GSV Base Volume Unit : Standard cubic feet

Special GSV Conv Factor : 1

Special GSV Flow Unit Text : NONE

Special GSV Total Text : NONE

Special Mass Base Unit : G

Special Mass Conv Factor : 1

Special Mass Flow Text : NONE

Special Mass Time Unit : SEC

Special Mass Total Text : NONE

Special Volume Base Unit : L

Special Volume Conv Factor : 1

Special Volume Flow Text : NONE

Special Volume Time Unit : SEC

Special Volume Total Text : NONE

Temperature Unit : C

Volume Flow Unit : L/MIN

MVD Channel Assignments

Channel B Power : Active (internally powered)

Assignments

Event 1 Variable : Density

Event 2 Variable : Density

Frequency1 Scaling Method : Frequency = Flow

Frequency Variable 1 : Mass Flow Rate

mA1 Variable : Mass Flow Rate

Ranges

Event 1 Setpoint : 0

Event 1 Type : Event Low (Event "OFF" if PV > SP)

Event 2 Setpoint : 0

Event 2 Type : Event Low (Event "OFF" if PV > SP)

Frequency1 Active State : Active High

Frequency1 Hertz : 1000

Frequency1 Output Mode : Single

Frequency1 Pulses/Unit : 1.554404

Frequency1 Rate : 643.3333

Frequency1 Units/Pulse : 0.6433333

mA1 LRV : 0

mA1 URV : 643.3333

Faults

Frequency1 Fault Behavior : Upscale

Faults

Frequency1 Fault Value : 15000
mA1 Fault Behavior : Downscale (Default)
mA1 Fault Value : 2

Other

Calibration Process ID : 1.37235262
Core Software Rev : 35
Density Cutoff : 0.2
Density Damping : 0.8
Density High Limit : 5
Density Low Limit : 0
Direction : FORWARD
Fault Dwell Time : 0
Feature Key : 1
Flow Damping : 0.8
HART Device ID : 4417435
LD Type : 0
Mass Flow Cutoff : 1.836
Pressure Comp Line Pressure : 0
Pressure Compensation State : OFF
RS485 Baud : 1200 baud
RS485 Parity : Odd
RS485 Protocol : HART
Slug Duration : 0
Tag :
Temperature Damping : 2.4
Transmitter Software Rev : 80
Volume Flow Cutoff : 0.11016

24071468